7.0 [177]
15.4 [390]
13.0 [331]
10.8 [273]
1.1 [28]
5.8 [146]

RETURN TO HEATER 1 SWEAT
HOT WATER INLET 2 SWEAT
MIXED WATER OUTLET 2 SWEAT
COLD WATER INLET 2 SWEAT
RECIRC RETURN 1-1/2 SWEAT

BRAINSCAN

SERVICE BY-PASS (NORMALLY CLOSED)

PRESSURE GAUGE
THERMOMETER
BALL VALVE
STRAINER
SPRING CHECK VALVE

49.0 [1245]

DRV80 GEN 2

CHECK VALVE

50.0 [1270]

64.0 [1626]

13.1 [333]

56.5 [1435]
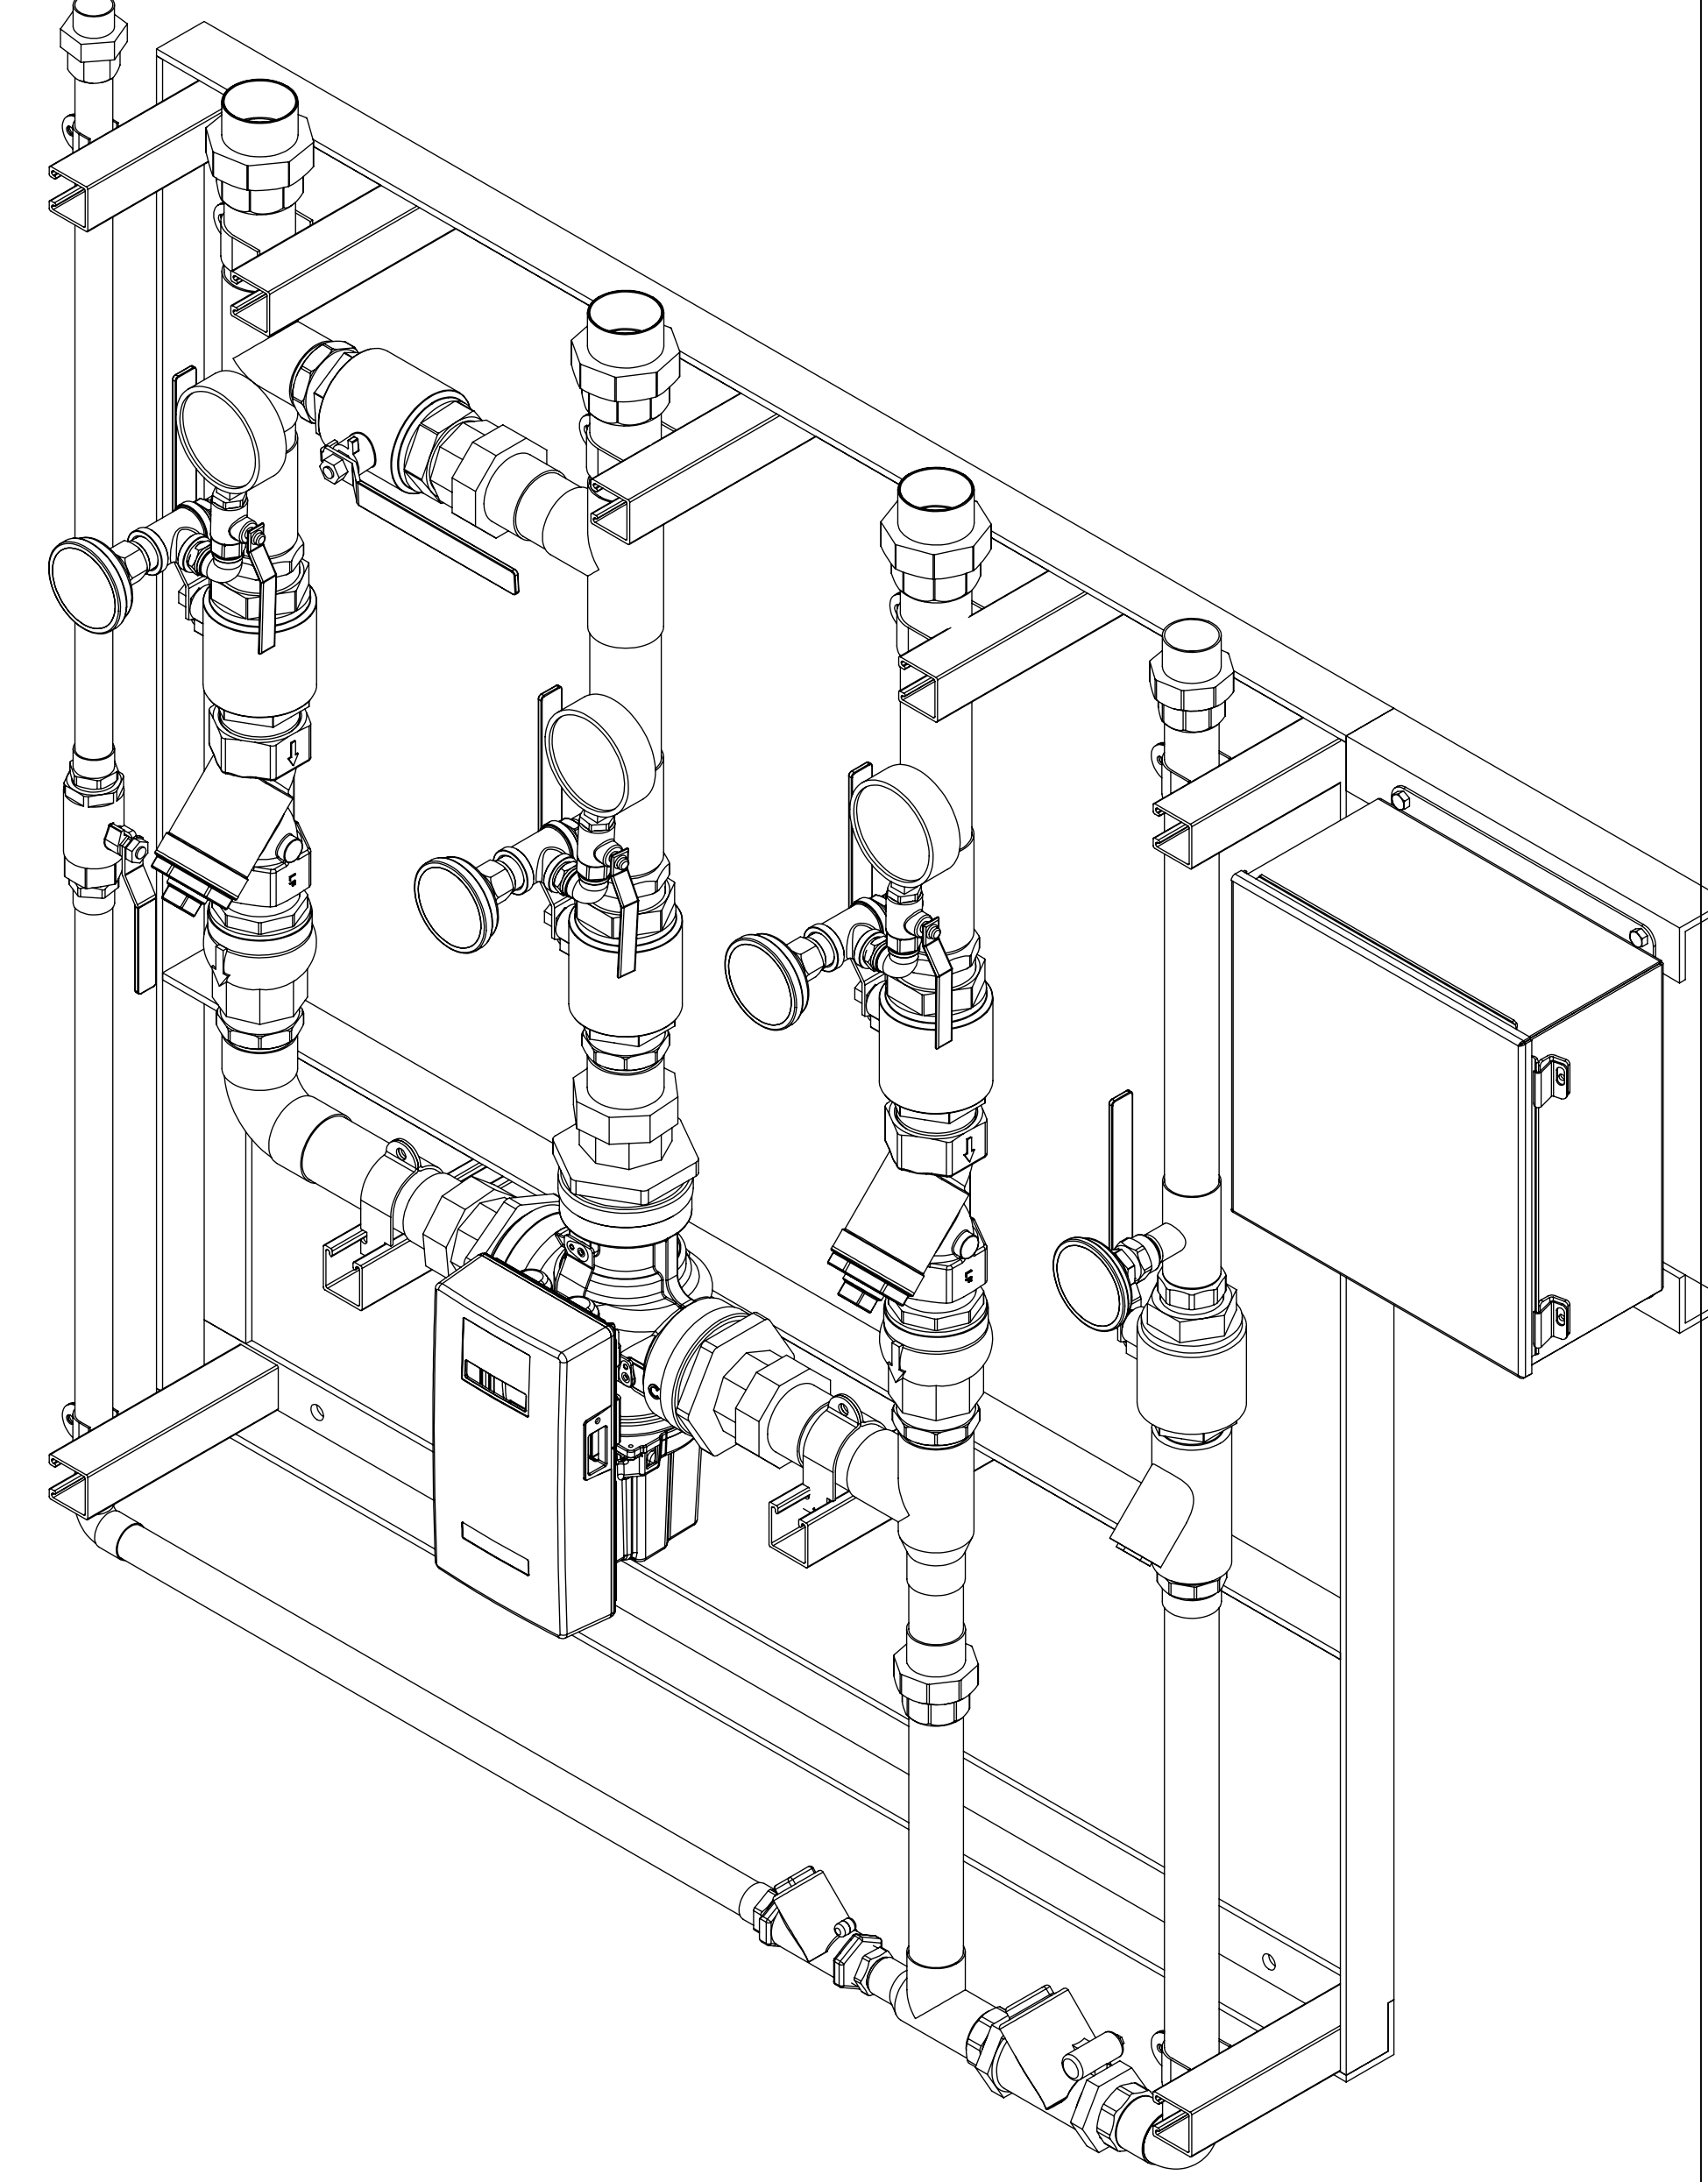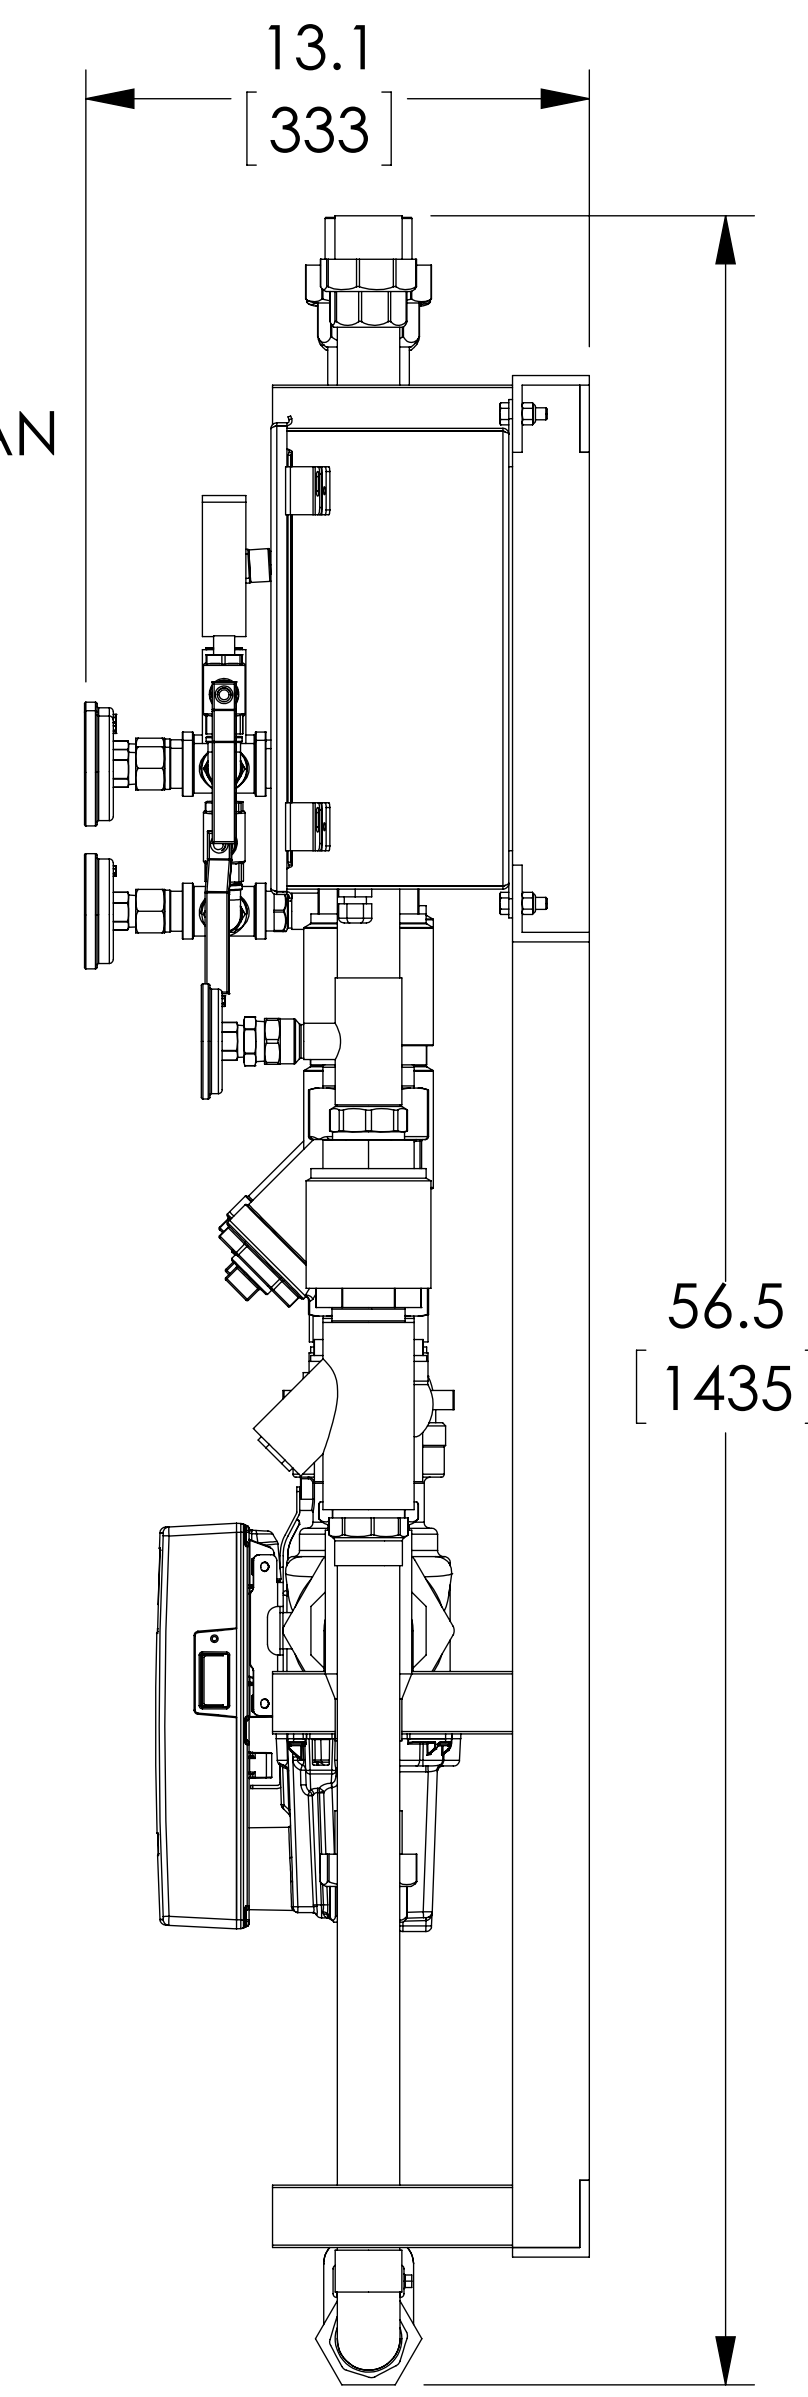
NOTE:
ALL VALVES AND FITTINGS IN THIS ASSEMBLY CONTAIN LESS THAN 0.25% LEAD BY WEIGHTED AVERAGE