


APPROVED  
DRAWING


DRAWING APPROVED. PROCEED WITH FABRICATION.  
BY Charlie Thomas DATE 9-11-01  
CHANGES OTHER THAN THOSE BY OUR  
ERROR ARE SUBJECT TO A CHARGE.

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	1	Original Drawing	9-11-01	

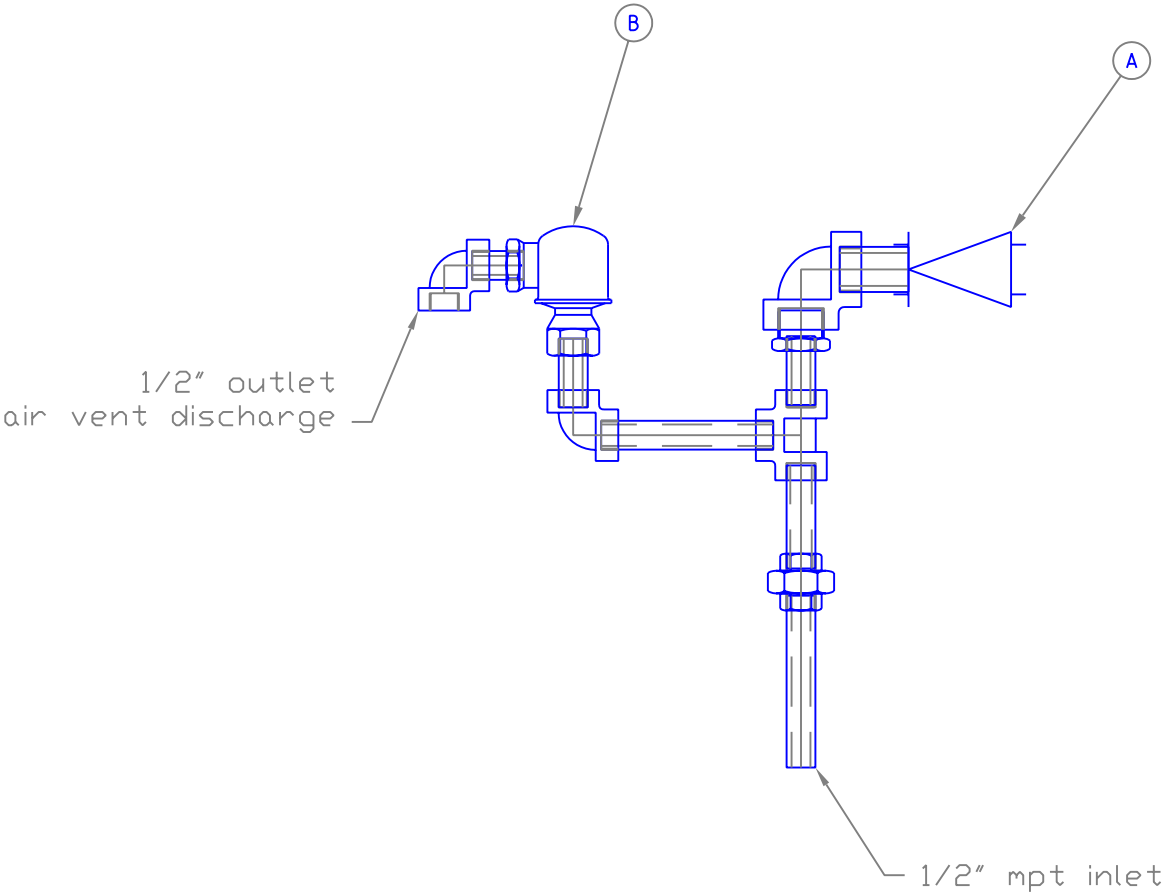

B	1	1/2"-TS-2-THERMOSTATIC-VENT	BRONZE
A	1	JOHNSON-VBA	BRONZE
ITEM	QTY	DESCRIPTION	MATERIAL

Notes:  
1. All fittings shall be 150#, malleable iron threaded  
2. All pipe shall be schedule 40 seamless threaded  
3. All joints shall be sealed with teflon tape and teflon pipe dope



Campbell-Sevey, Inc.

LP air vent/VB assy

SIZE B	FSCM NO.	DWG NO. 09-11-2001-A	REV 1
SCALE 1" = 6"		SHEET	

Do Not Duplicate

unless prior written approval has been obtained from a  
qualified representative from Campbell-Sevey, Inc.  
(952) 935-2345